










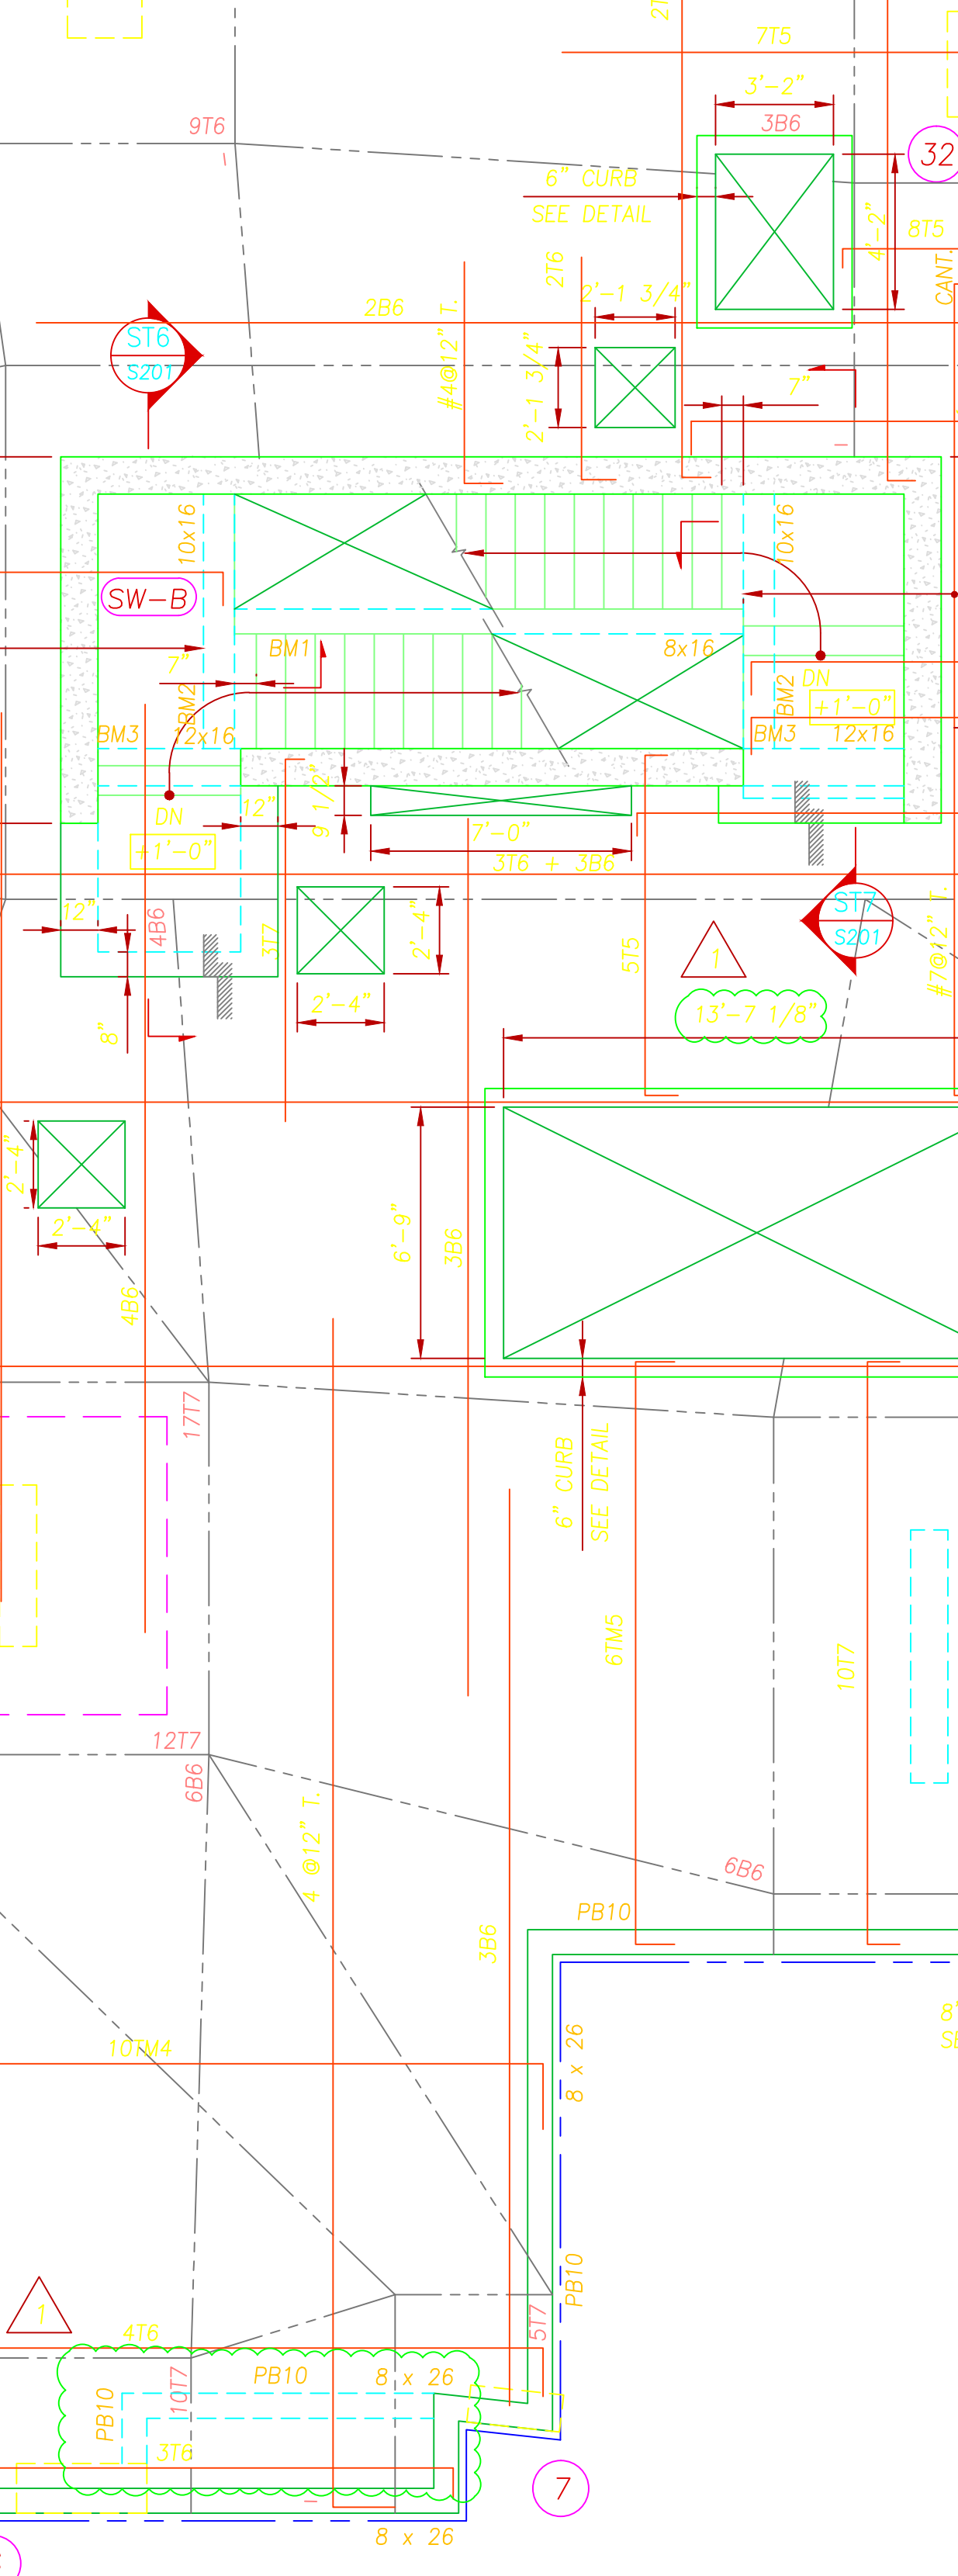
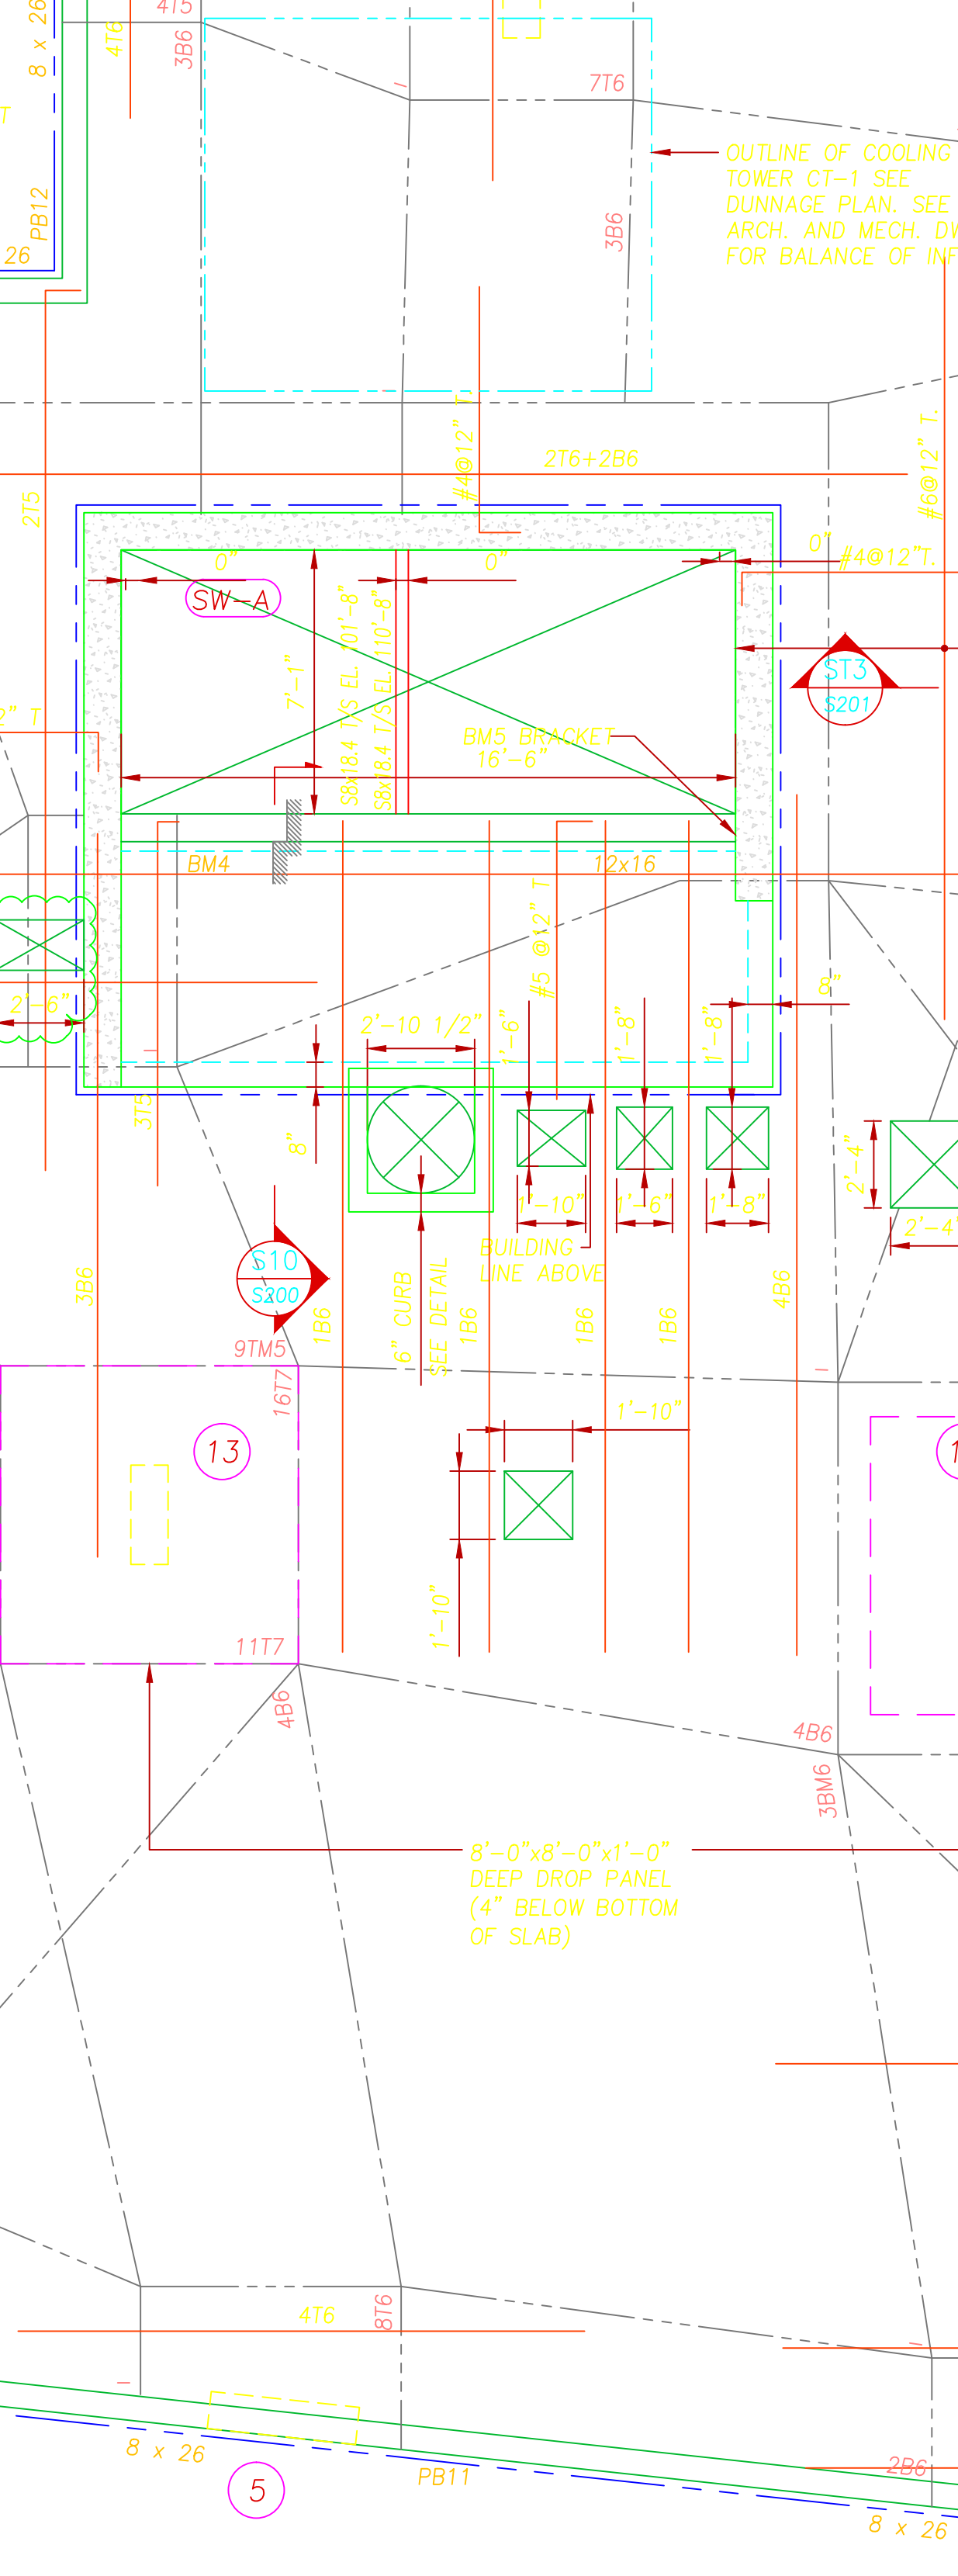
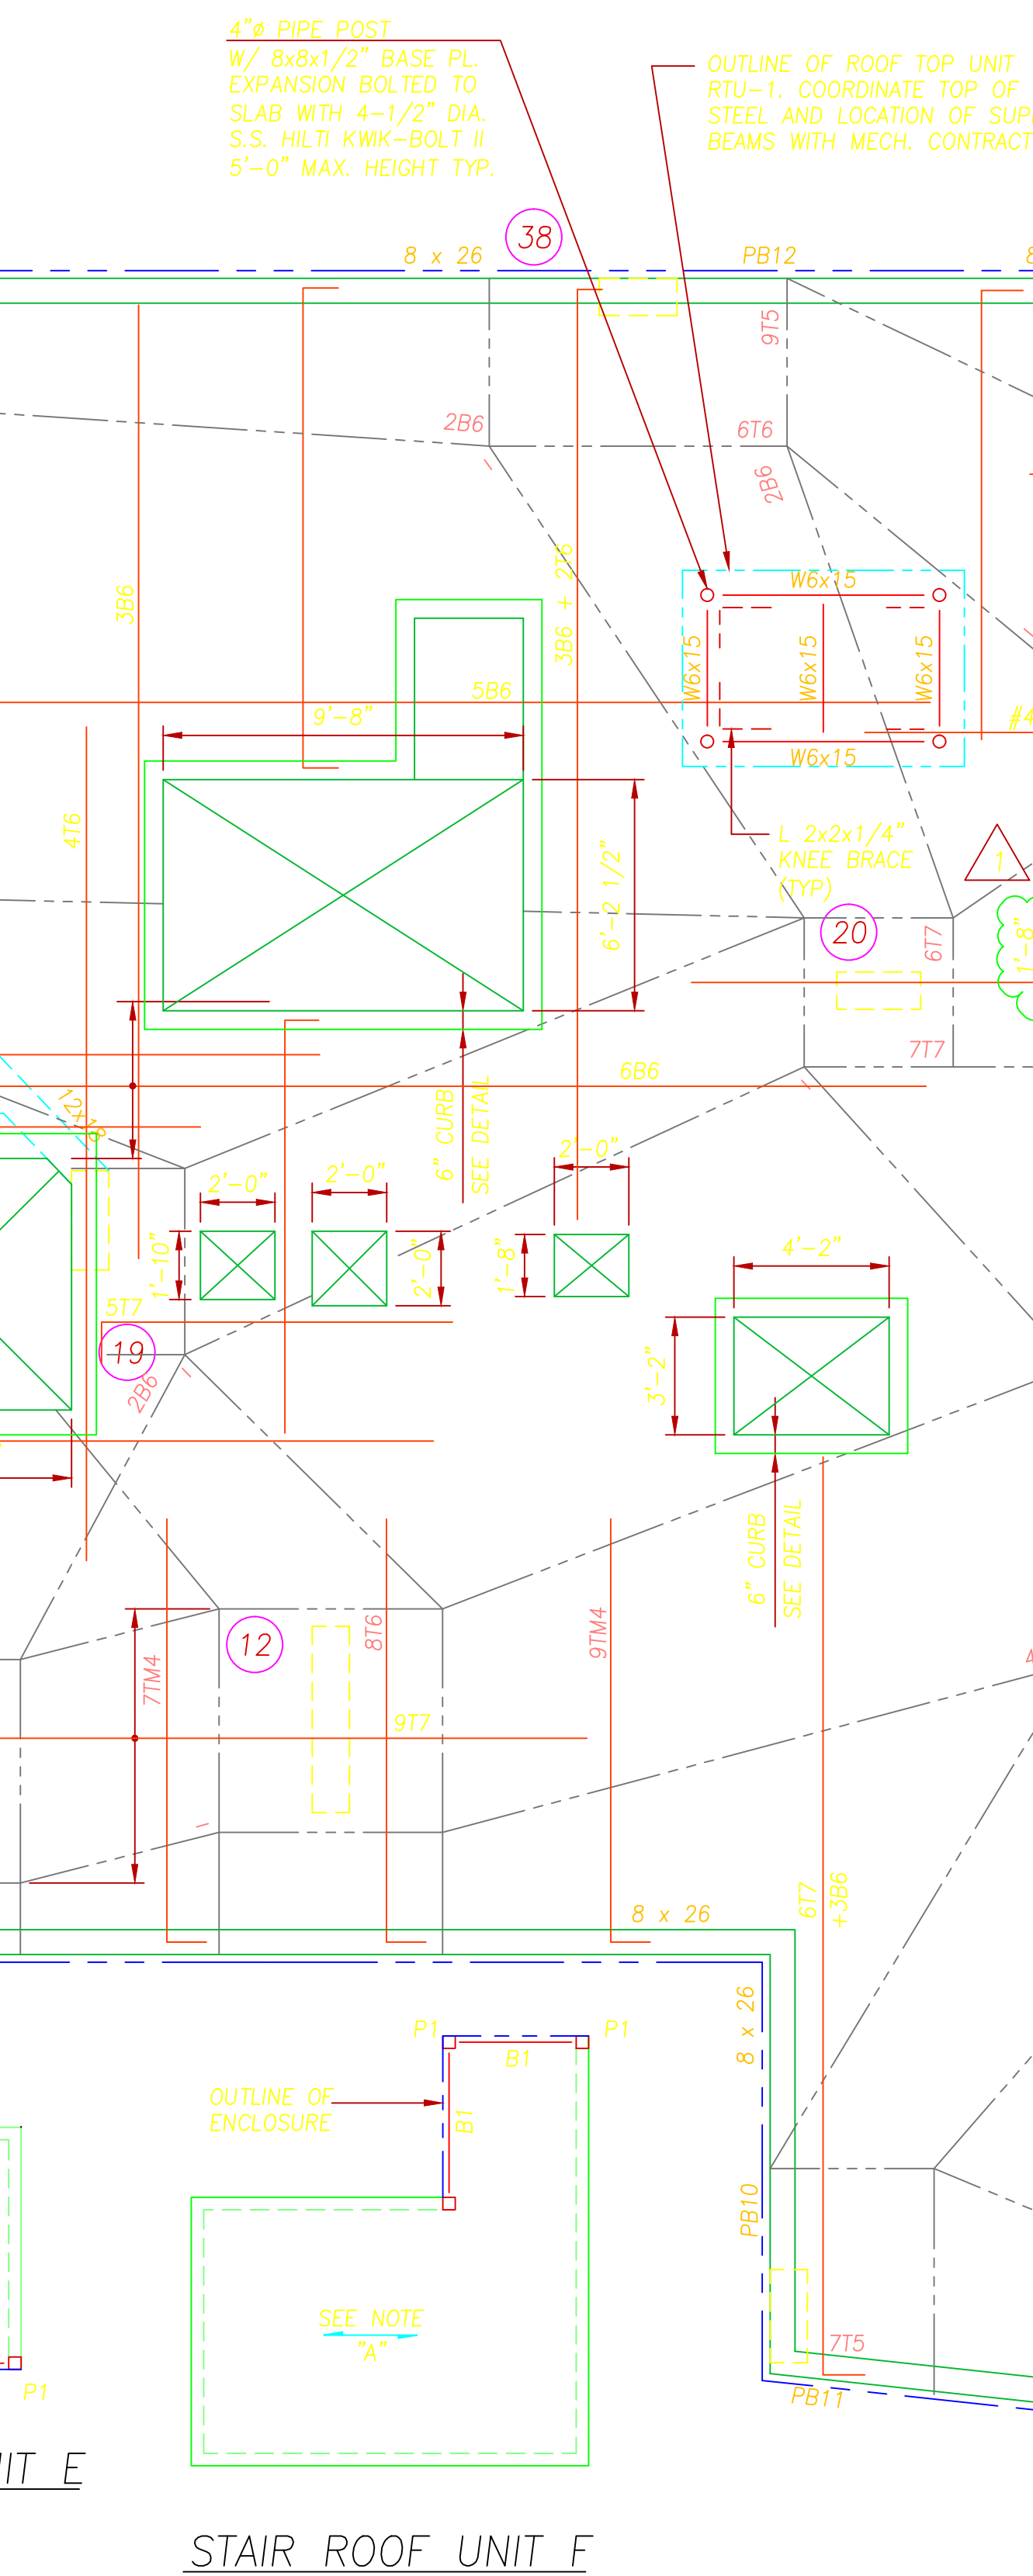
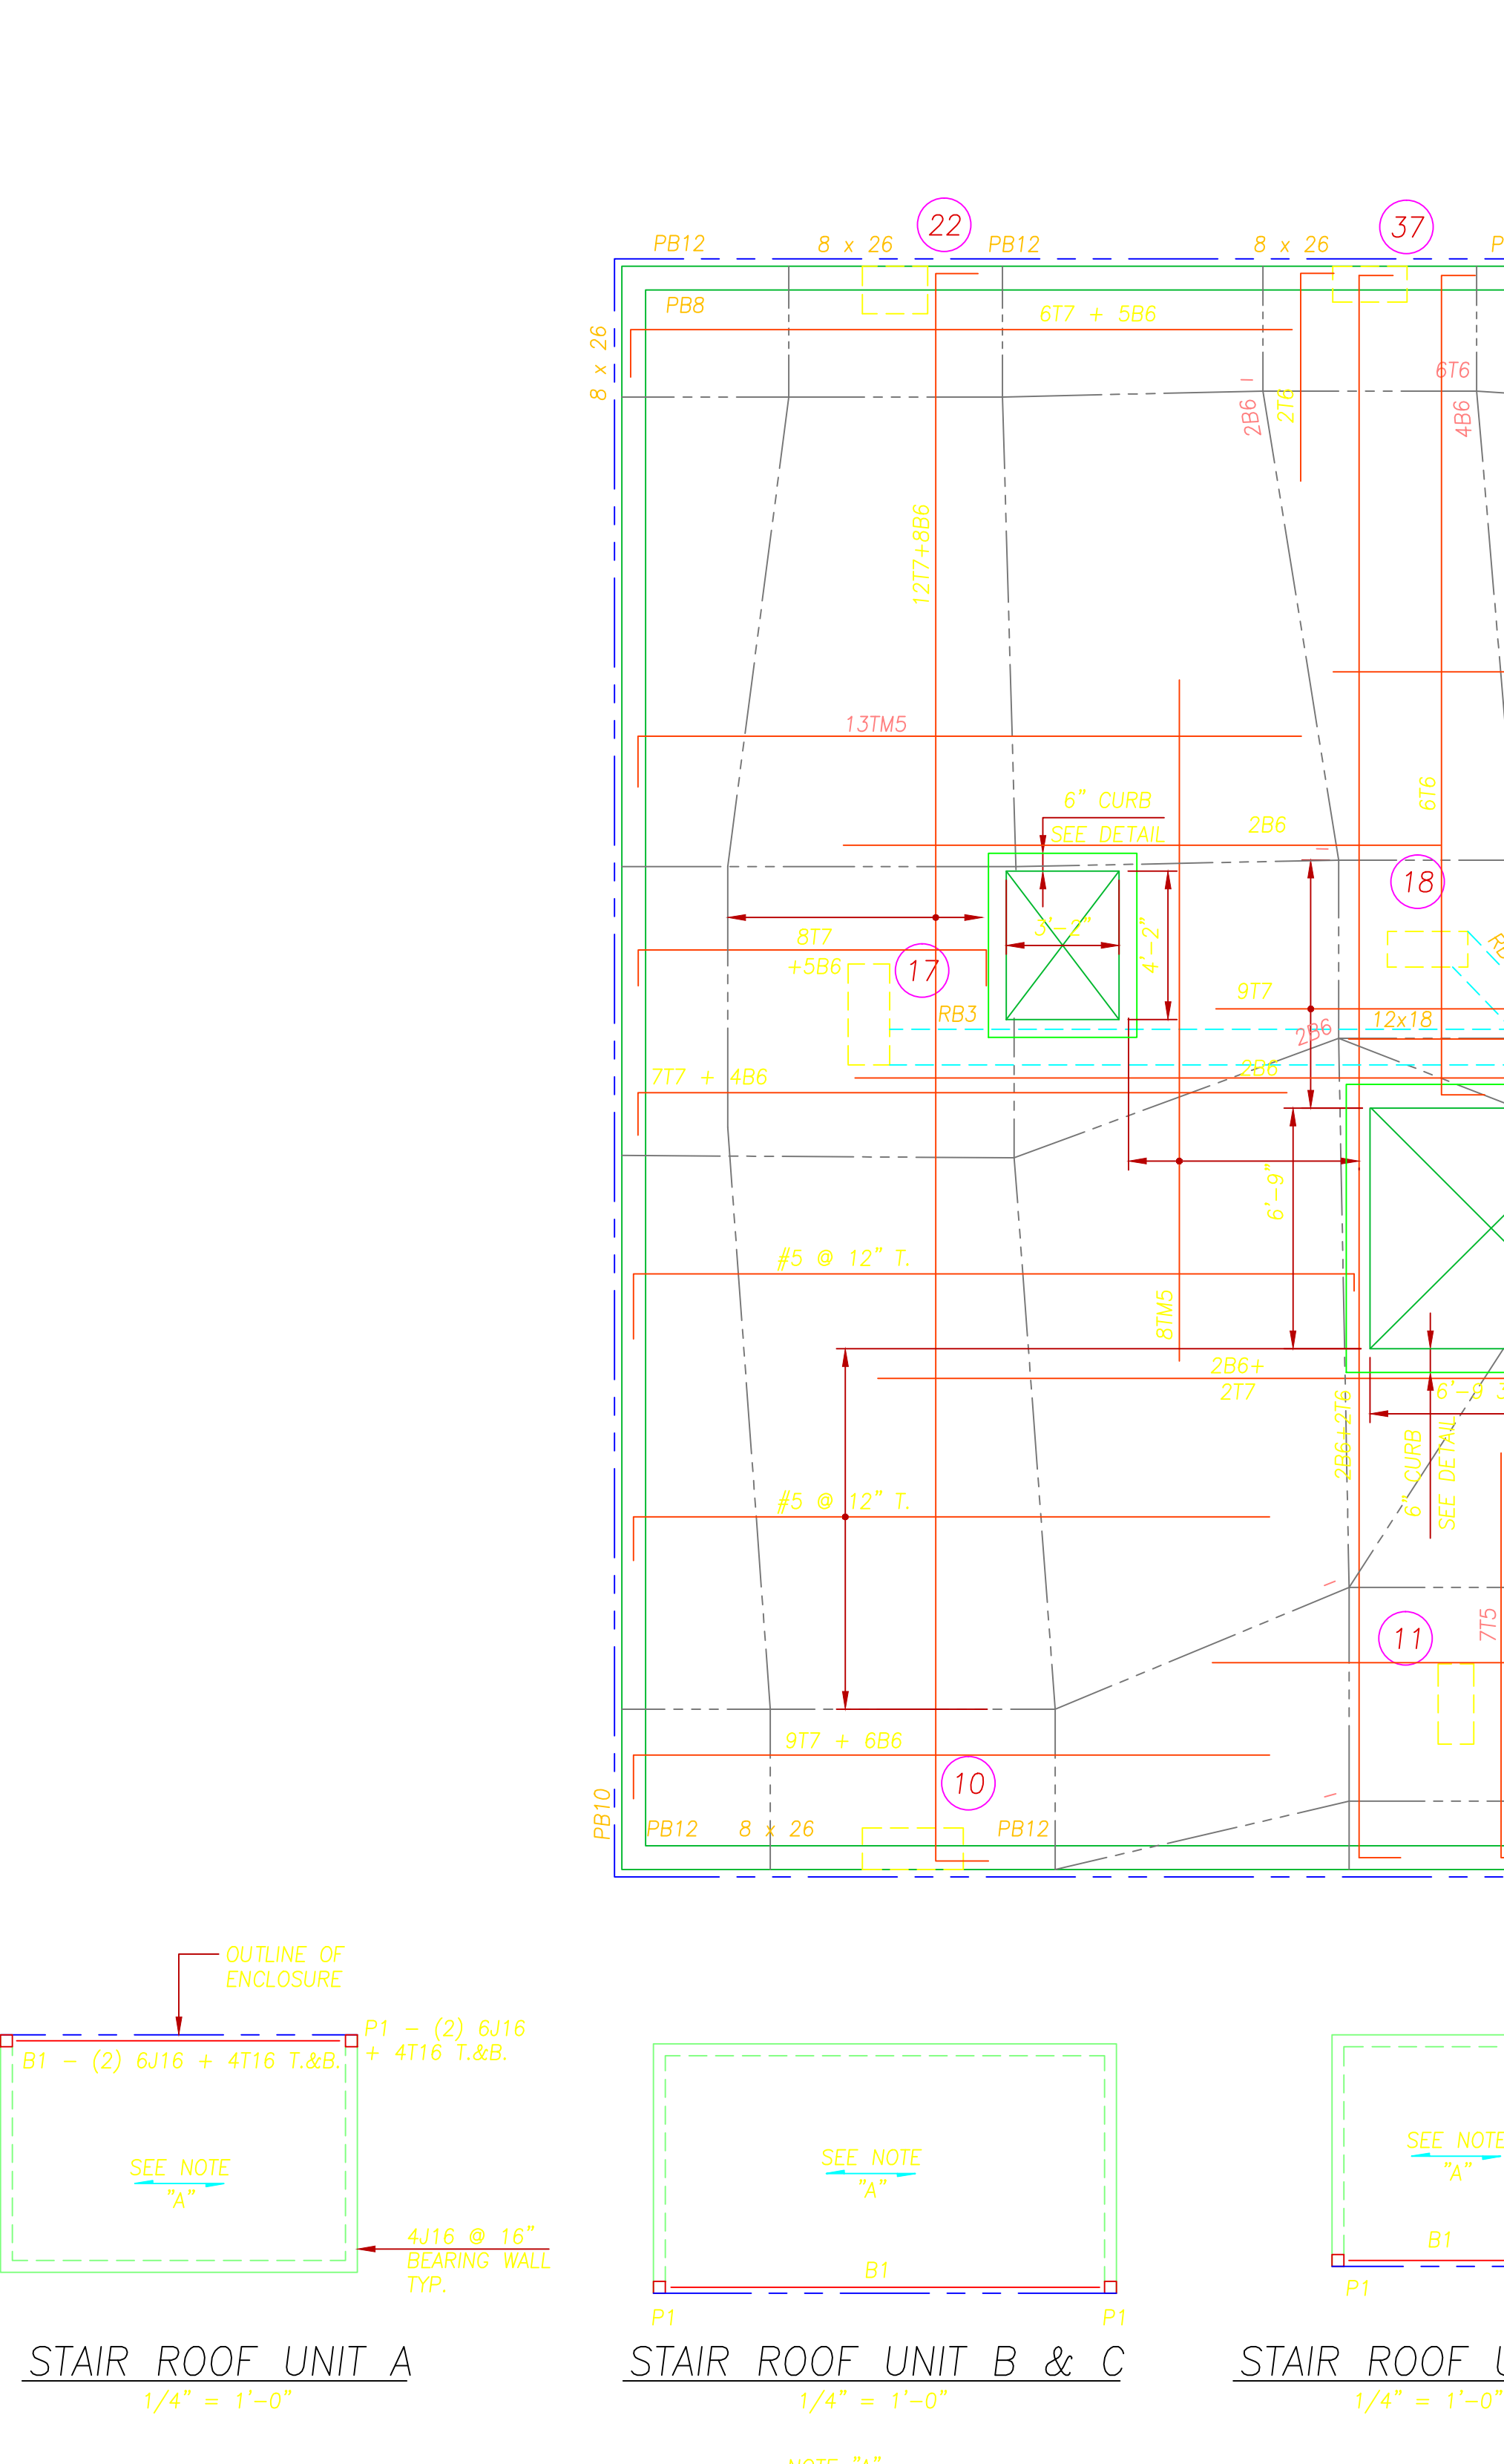


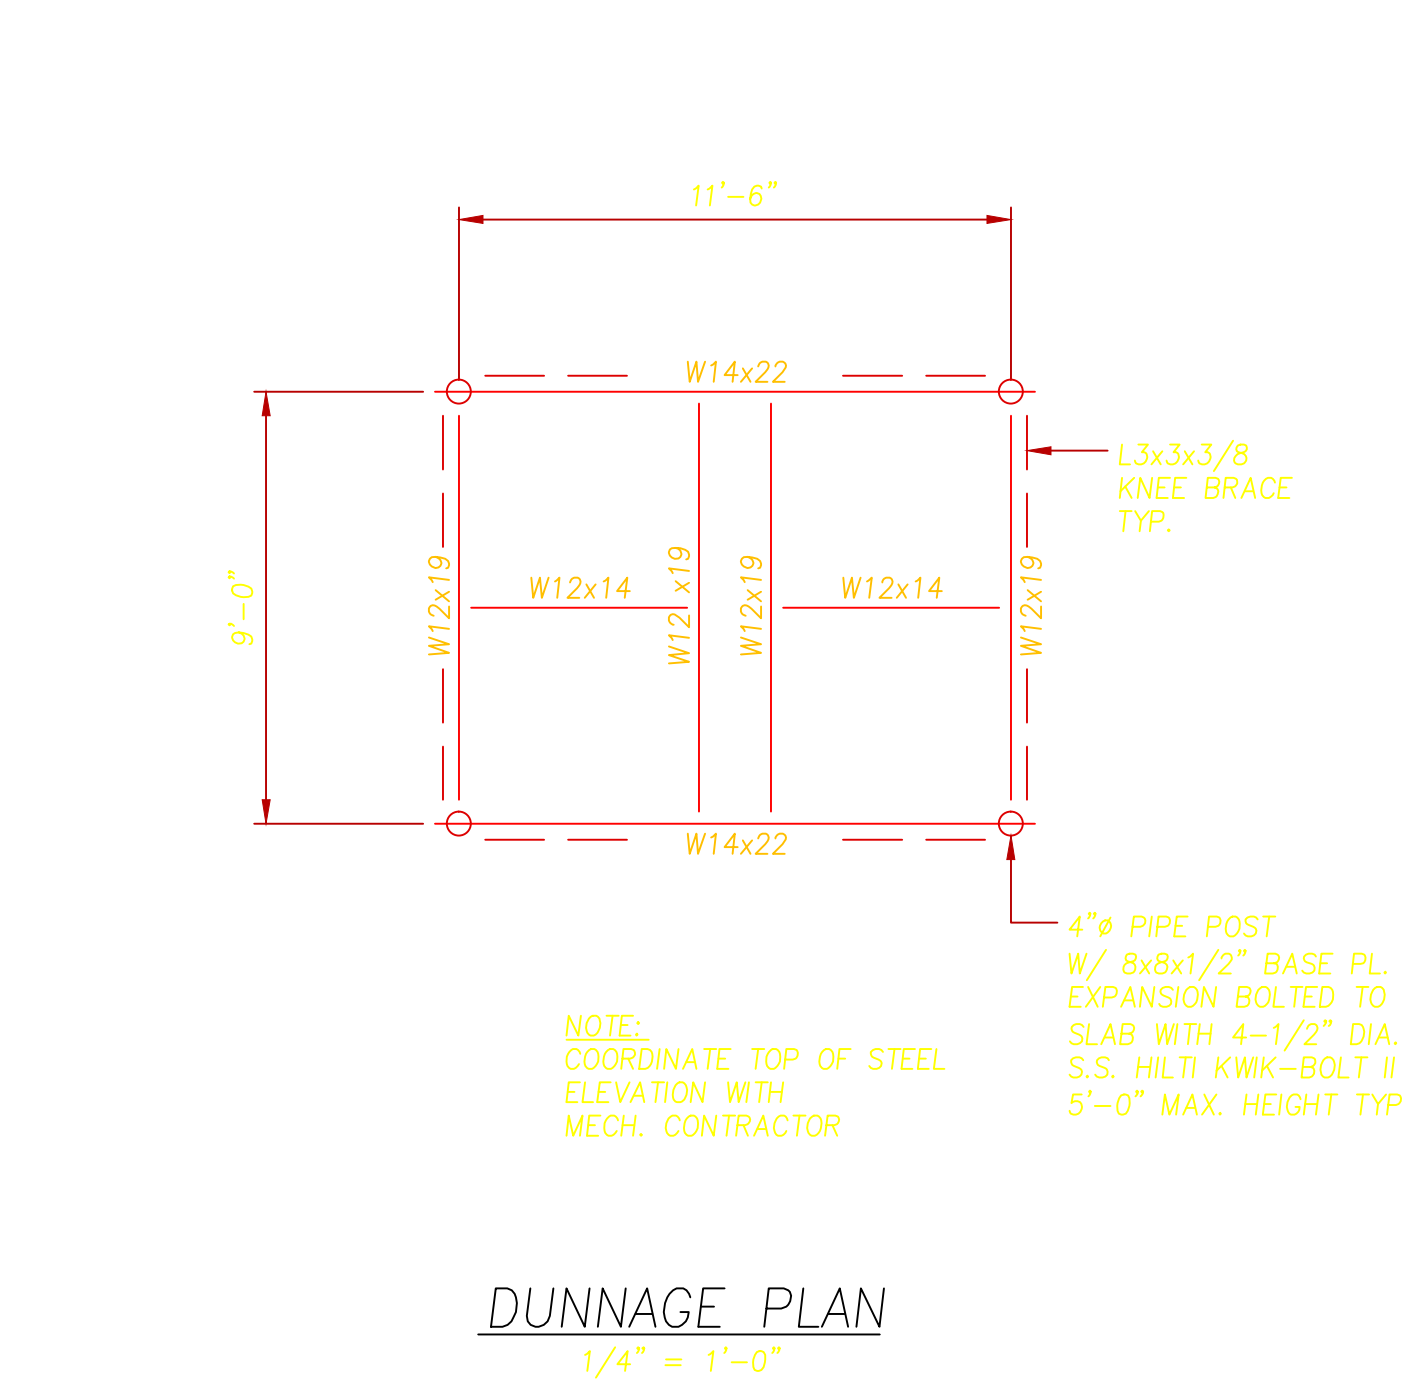


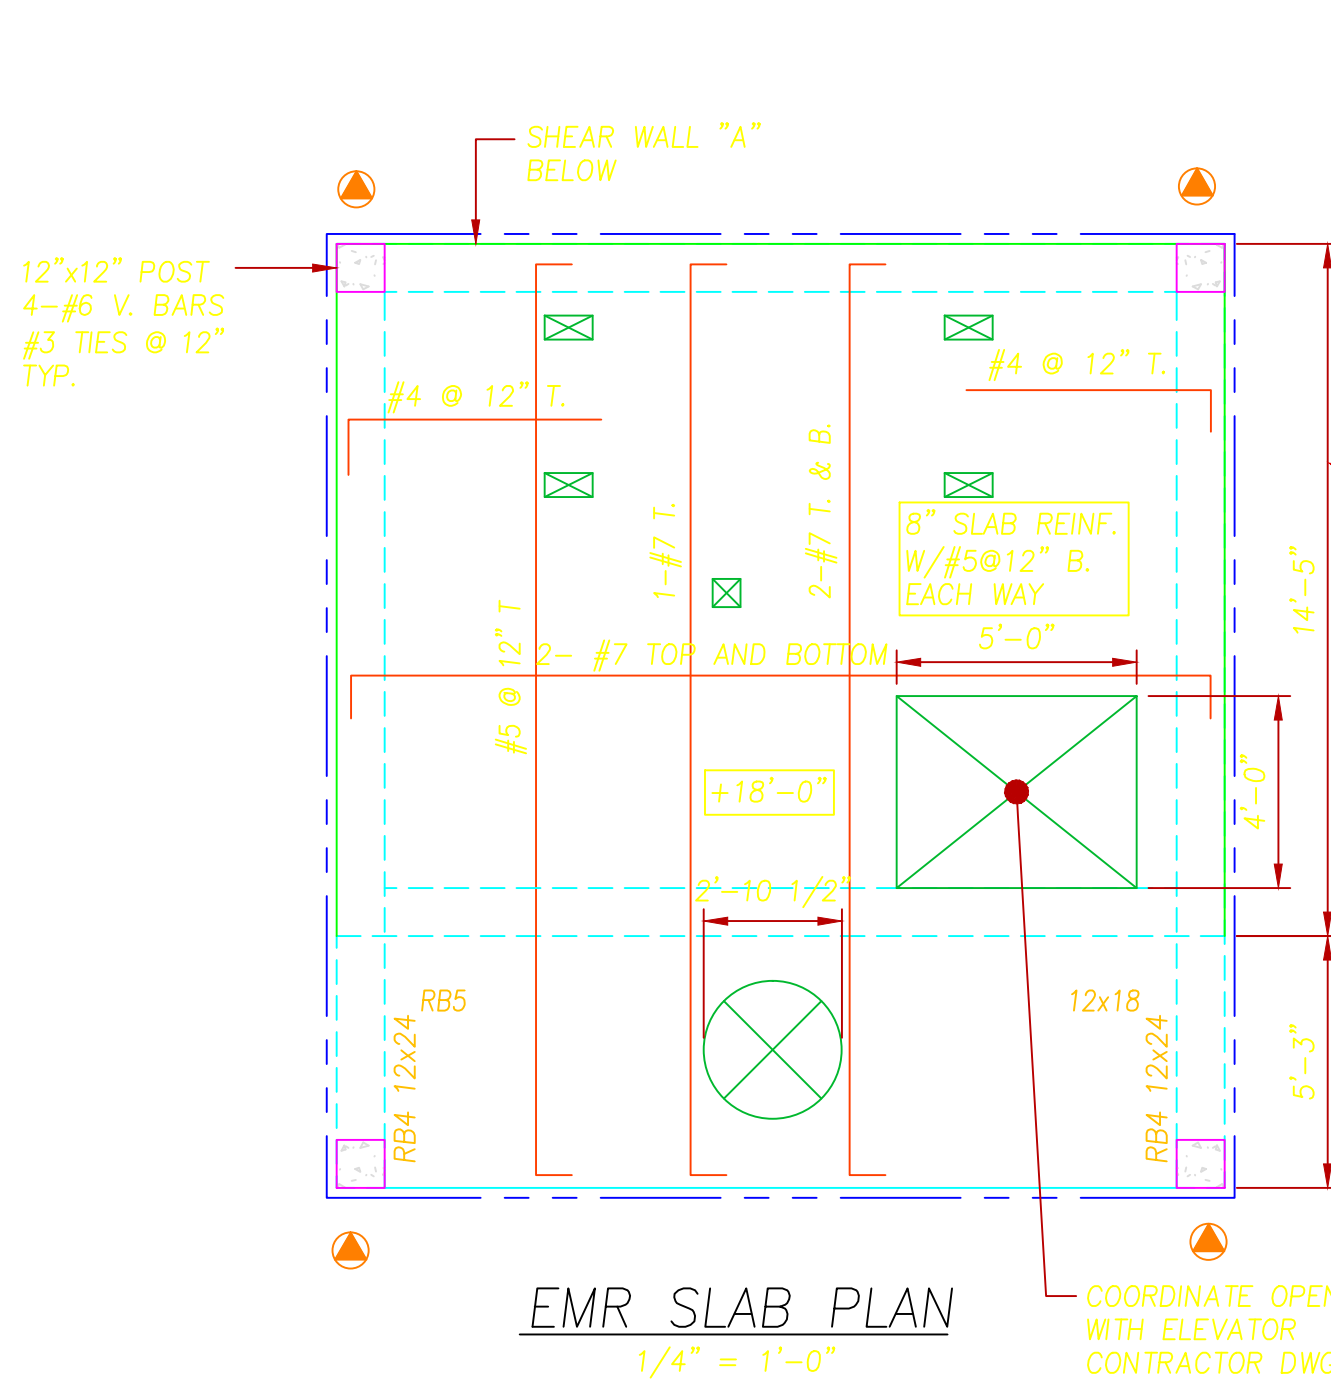


BEAM SCHEDULE								
MARK	BEAM SIZE		BOTTOM REINFORCING	CONTINUOUS TOP REINFORCING	STIRRUPS			REMARKS
	WIDTH	DEPTH			SIZE	TYPE	SPACING EACH END	
RB1	12	24	2 - #8	2 - #8	#4		12"	—
RB2	12	18	2 - #6	2 - #6	#4		8"	—
RB3	12	18	2 - #9	2 - #9	#4		8"	—
RB4	12	24	2 - #6	2 - #9	#4		10"	—
RB5	12	18	2 - #8	2 - #6	#4		8"	—
RB6	12	18	2 - #8	2 - #6	#3		8"	—
RB7	12	18	2 - #5	2 - #5	#3		12"	—
PB10	8	26	2 - #5	2 - #5	#3		12"	—
PB11	8	26	2 - #8	2 - #8	#3		12"	—
PB12	8	26	2 - #7	2 - #7	#3		12"	—



- NOTES:
- TOP OF CONCRETE SLAB IS SET AT ELEVATION +101'-8" UNLESS NOTED THUS [ELEVATION] FROM SLAB ELEVATION.
 - FOR GENERAL NOTES SEE DRAWING S-400.
 - FOR COLUMN LOCATIONS SEE DRAWING S-001.
 - FOR SECTIONS AND DETAILS SEE DRAWING S-200 & S-201.
 - FOR COLUMN SCHEDULE SEE DRAWING S-300.
 - FOR SHEAR WALL SCHEDULE SEE S-301.
 - FOR TYPICAL DETAILS SEE DRAWING S-401 THRU S-403.
 - FOR LOCATION OF SLAB OPENINGS SEE ARCH. DRAWINGS.
 - A MINIMUM OF 3" SHALL BE PROVIDED BETWEEN PIPE SLEEVES AT LEAST ONE #6 x 9'-0" (TOP AND BOTTOM) SHALL RUN CONTINUOUS THROUGH THE SLEEVES.
 - FLOOR CONSTRUCTION SHALL BE AN 8" FLAT PLATE WITH A CONTINUOUS BOTTOM GRID OF #4 @ 12" ON CENTER UNLESS OTHERWISE NOTED.
 - FOR SIZE AND LOCATION OF CONCRETE CURBS, SEE ARCHITECTURAL DRAWINGS. FOR CONSTRUCTION SEE TYPICAL DETAILS ON S-401.
 - ADD 3-#6 BOTTOM BARS (ADDITIONAL REINFORCEMENT FOR THE TRANSFER OF LATERAL FORCES IN THE SLAB-COLUMN JOINT) DIRECTLY OVER THE COLUMN IN BOTH DIRECTIONS. BARS SHALL EXTEND ONE-QUARTER OF THE SPAN LENGTH IN EACH DIRECTION. BARS SHALL BE PLACED WITHIN THE CRITICAL SLAB WIDTH. CRITICAL SLAB WIDTH IS DEFINED AS "COLUMN DIMENSION PLUS 3 TIMES THE GROSS SLAB DEPTH".
 - SLAB TOP REINFORCEMENT SHALL CONFORM TO TYPICAL DETAILS ON S-402, UNLESS OTHERWISE NOTED ON PLAN. BOTTOM BARS SHOWN ON PLAN ARE IN ADDITION TO BOTTOM GRID.
 - FOR BALANCE OF BEAM SCHEDULE SEE S-103.
 - ALL EXPOSED STEEL SHALL BE PAINTED PER ARCHITECTURAL SPECIFICATION.

1

BULLETIN #1

ISSUED FOR CONSTRUCTION

ISSUED FOR BUILDING DEPARTMENT

NO. REVISIONS | SUBMISSIONS

DATE

11.20.06

06.01.06

04.25.06

FX FOWLE

FX FOWLE ARCHITECTS, PC | 122 WEST 10TH STREET | NEW YORK, NY 10011 | T 212.687.1700 | F 212.687.8776 | WWW.FXFOWLE.COM

SEVERUD ASSOCIATES, P.C.
403 Seventh Avenue, Suite 303, New York, NY 10018 212-886-0700
DAGHER ENGINEERING, PLLC
25 Broadway, New York, NY 10006 212-485-0301
LANGAN ENGINEERING
17 West 10th, 3rd Floor 3rd Street, New York, NY 10011 212-475-9400
VDA
50 Rector Street, Livingston NJ 07039 973-994-8220
CERAMI
400 Fifth Avenue, New York, NY 10018 212-370-1776

462 WEST 58TH STREET
462 WEST 58TH STREET | NEW YORK, NY
DRAWING TITLE
ROOF FRAMING PLAN

Seal

Drawn:
ART

Checked:
MR

Reviewed:
JMS

Date:
06.01.06

Scale:
1/4" = 1'-0"

Project No:
0207-0006

Sheet No:
S-106.DWG

Drawn By:
[Signature]

S-107