TYPICAL DETAIL OF MOUNTING METAL HALIDE LUMINAIRE
ТИПОВЫЙ УЗЕЛ КРЕПЛЕНИЯ СВЕТИЛЬНИКА МГЛ

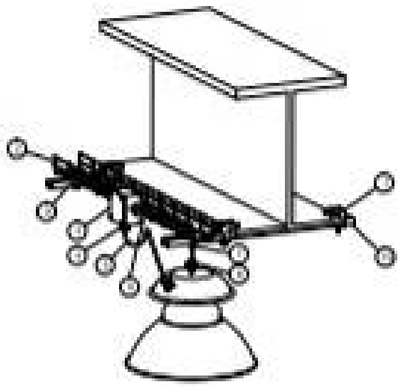

СПЕЦИФИКАЦИЯ МАТЕРИАЛОВ

#	НАИМЕНОВАНИЕ	ТИП	КОД	ПРИМЕЧАНИЕ
1	[illegible]	[illegible]	[illegible]	[illegible]
2	[illegible]	[illegible]	[illegible]	[illegible]
3	[illegible]	[illegible]	[illegible]	[illegible]
4	[illegible]	•	[illegible]	[illegible]
5	[illegible]	•	•	
6	[illegible]	[illegible]	[illegible]	[illegible]
7	[illegible]	[illegible]	[illegible]	[illegible]
8	[illegible]	[illegible]	[illegible]	[illegible]
9	[illegible]	[illegible]	[illegible]	[illegible]
10	[illegible]	[illegible]	[illegible]	[illegible]
11	[illegible]	[illegible]	[illegible]	[illegible]

TYPICAL DETAIL OF MOUNTING FLUORESCENT LUMINAIRE
(1-PHASE NETWORK)
ТИПОВЫЙ УЗЕЛ КРЕПЛЕНИЯ ЛЮМИНЕСЦЕНТНОГО СВЕТИЛЬНИКА
(1-Ф СЕТЬ)

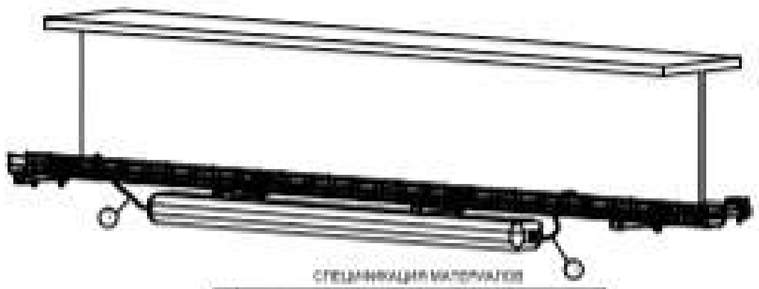

СПЕЦИФИКАЦИЯ МАТЕРИАЛОВ

#	НАИМЕНОВАНИЕ	ТИП	КОД	ПРИМЕЧАНИЕ
1	[illegible]	•	•	•

TYPICAL DETAIL OF MOUNTING FLUORESCENT LUMINAIRE
(3-PHASE NETWORK)
ТИПОВЫЙ УЗЕЛ КРЕПЛЕНИЯ ЛЮМИНЕСЦЕНТНОГО СВЕТИЛЬНИКА
(МАГИСТРАЛЬНАЯ 3-Ф СЕТЬ)

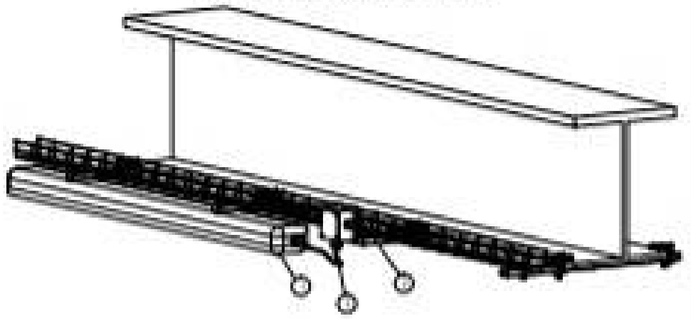

СПЕЦИФИКАЦИЯ МАТЕРИАЛОВ

#	НАИМЕНОВАНИЕ	ТИП	КОД	ПРИМЕЧАНИЕ
1	[illegible]	•	•	•
2	[illegible]	•	•	•
3	[illegible]	•	•	•

TYPICAL DETAIL OF MOUNTING POWER CABLE TRAY
ТИПОВЫЙ УЗЕЛ КРЕПЛЕНИЯ СИЛОВЫХ ЛОТКОВ

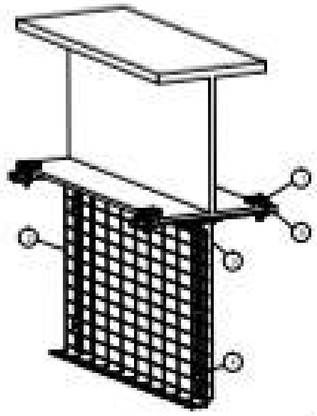

СПЕЦИФИКАЦИЯ МАТЕРИАЛОВ

#	НАИМЕНОВАНИЕ	ТИП	КОД	ПРИМЕЧАНИЕ
1	[illegible]	[illegible]	[illegible]	[illegible]
2	[illegible]	[illegible]	[illegible]	[illegible]
3	[illegible]	[illegible]	[illegible]	[illegible]
4	[illegible]	[illegible]	[illegible]	[illegible]
5	[illegible]	[illegible]	•	[illegible]
6	[illegible]	[illegible]	•	[illegible]

TYPICAL DETAIL OF BINDING CABLE TRAY TO THE SANDWICH PANEL
ТИПОВЫЙ УЗЕЛ КРЕПЛЕНИЯ ЛОТКА К СЕНДВИЧ ПАНЕЛИ



СПЕЦИФИКАЦИЯ МАТЕРИАЛОВ

#	НАИМЕНОВАНИЕ	ТИП	КОД	ПРИМЕЧАНИЕ
1	[illegible]	[illegible]	[illegible]	[illegible]
2	[illegible]	[illegible]	[illegible]	[illegible]
3	[illegible]	•	[illegible]	[illegible]
4	[illegible]	[illegible]	•	[illegible]
5	[illegible]	•	•	

TYPICAL DETAIL OF MOUNTING POWER CABLE TRAYS ALONG TO EXTERNAL WALL (AXIS Ю)
ТИПОВЫЙ УЗЕЛ КРЕПЛЕНИЯ СИЛОВЫХ ЛОТКОВ ВДОЛЬ ВНЕШНЕЙ СТЕНЫ (ОСЬ Ю)

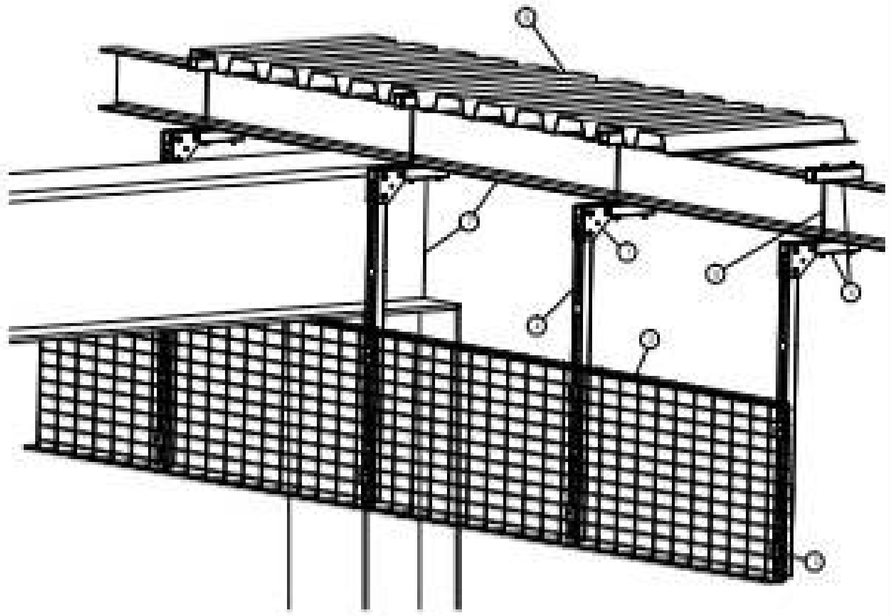

СПЕЦИФИКАЦИЯ МАТЕРИАЛОВ

#	НАИМЕНОВАНИЕ	ТИП	КОД	ПРИМЕЧАНИЕ
1	[illegible]	[illegible]	[illegible]	[illegible]
2	[illegible]	[illegible]	[illegible]	[illegible]
3	[illegible]	[illegible]	[illegible]	[illegible]
4	[illegible]	[illegible]	[illegible]	[illegible]
5	[illegible]	[illegible]	[illegible]	[illegible]
6	[illegible]	•	•	•
7	[illegible]	•	•	•

TYPICAL DETAIL OF CROSSING CABLE TRAYS WITH OTHER UNILITIES
ТИПОВЫЙ УЗЕЛ ПЕРЕСЕЧЕНИЯ КАБЕЛЬНЫХ ЛОТКОВ С КОММУНИКАЦИЯМИ

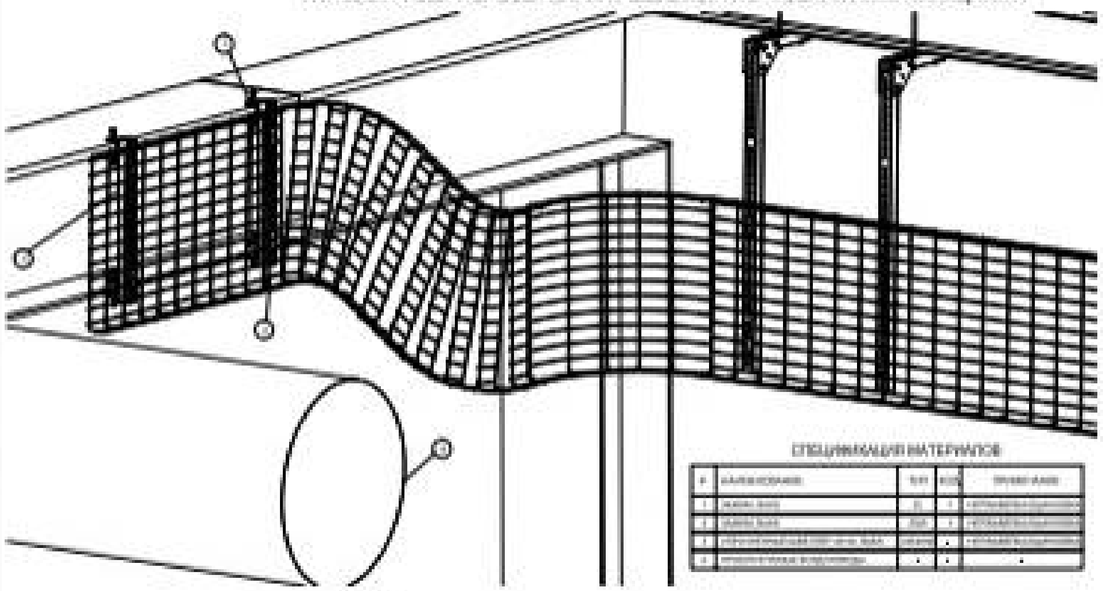

СПЕЦИФИКАЦИЯ МАТЕРИАЛОВ

#	НАИМЕНОВАНИЕ	ТИП	КОД	ПРИМЕЧАНИЕ
1	[illegible]	[illegible]	[illegible]	[illegible]
2	[illegible]	[illegible]	[illegible]	[illegible]
3	[illegible]	[illegible]	[illegible]	[illegible]
4	[illegible]	•	•	•

NOTES:
УКАЗАНИЯ:

- TYPICAL DETAILS OF MOUNTING CABLE TRAYS IN ROOM "LIV" TO BE SUPPLIED WITH ARRANGEMENTS OF PREVENTING SPONTANEOUS OPTIMISING.
- ВУТВЕРЖДЕНИЯ "LIV" ПРЕНЕВЕДЕТВЕННЫЙ ЧИСТОК ПРЕДУСМОТРЕТЬ МЕРЫ СЫМОПРОИЗВОЛЬНОМУ РАЗРУШЕНИЮ ПЫЛЕВ В ПЕЧЕ КРЕПЛЕНИЯ СОЛОВ

MOUNTING FREQUENCY FOR CABLE TRAYS
ШАГ КРЕПЛЕНИЯ ЛОТКОВ

#	ДИНАМИЧЕСКИЙ ПОТОК ЛИМ. ВЕСНИЧЕНИЕ OF CABLE TRAY, КМ	ШАГ МЕЖДУ КРЕПЛЕНИЯМИ, М MOUNTING FREQUENCY, М
1	[illegible]	1
2	[illegible]	1
3	[illegible]	1.0
4	[illegible]	1.0